

(*) - the material of the grate shall match the material of the pipe and shall be as follows:

a) **PVC:** Pipe - 4" Schedule 40 PVC meeting ASTM D-1785;
Grate - 4" PVC Snap-in Drain - meets ASTM D-2665, with Stainless Steel (Type 304) Cover, mounted with two 18-8 Stainless Steel Screws; Maximum opening size 1/4".

b) **HDPE:** Pipe - 4" HDPE meeting AASHTO M252, Type S;
Grate - 4" HDPE - meets ASTM D-3350; Maximum opening size 1/4".

Section A-A
Not to Scale

AREA INLET
(2012 Edition)

Area Inlet Notes

General

- Overland Park Municipal Code (OPMC) and Overland Park Design and Construction Standards Manual (OPDCSM) are incorporated, except as otherwise noted.
- All storm sewer structures shall be pre-cast or poured in place. If pre-cast structures are used, the tops shall be poured in place and the wall steel shall be left exposed to a height 2" below the finish top elevation, or as directed by the City Engineer.
- Pre-cast shop drawings are to be approved by the City Engineer for publicly financed or administered projects. Pre-cast shop drawings for privately financed projects are to be submitted to the Engineering Services Division of the Planning and Development Services Department.
- Do not scale these drawings for dimensions or clearances. Any questions regarding dimensions shall be brought to the attention of the City Engineer prior to construction.
- Berm location and elevation may vary. See grading plan for exact location.
- The first dimension listed in the construction notes is the "L" dimension. The second dimension is the "W" dimension. The concrete thickness and reinforcement shown is for boxes with ("L"+"H") and ("W"+"H") less than or equal to 20. For boxes with either of these calculations greater than 20, a special design is required.

Concrete


- Concrete used in this work shall be KCMMB4K, as approved by the Kansas City Metropolitan Materials Board, and shall meet the requirements of the OPMC.
- Inlet floors shall be shaped with non-reinforced concrete inverts to provide smooth flow.
- Bevel all exposed edges with 3/4" triangular molding.

Reinforcing Steel


- Reinforcing steel shall be new billet, minimum Grade 60 as per ASTM A615, and shall be bent cold.
- All dimensions relative to reinforcing steel are to centerline of bars. 2" clearance shall be provided throughout unless noted otherwise. Tolerance of +/- 1/8" shall be permitted.
- All lap splices not shown shall be a minimum of 40 bar diameters in length.
- All reinforcing steel shall be supported on fabricated steel bar supports @ 3'-0" maximum spacing.
- All dowels shall be accurately placed and securely tied in place prior to placement of bottom slab concrete. Sticking of dowels into fresh or partially hardened concrete will not be acceptable.

Construction


- The bottom slab shall be at least 24 hours old before placing sidewall concrete. All sidewall forms shall remain in place a minimum of 24 hours after sidewalls are poured before removal, and after removal shall be immediately treated with membrane curing compound.
- Pipe connections to pre-cast structures shall have a minimum of 6" of concrete around the entire pipe within 2' of the structure.
- Material selection and compaction requirements for backfill around structures shall be as specified in the Manual of Infrastructure Standards, as promulgated by the City Engineer.

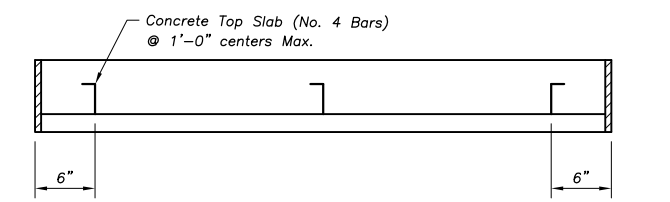

Top View
Not to Scale

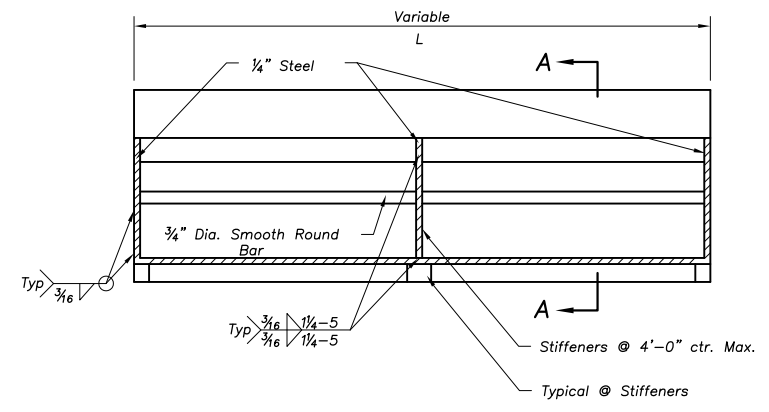

Front View
Not to Scale

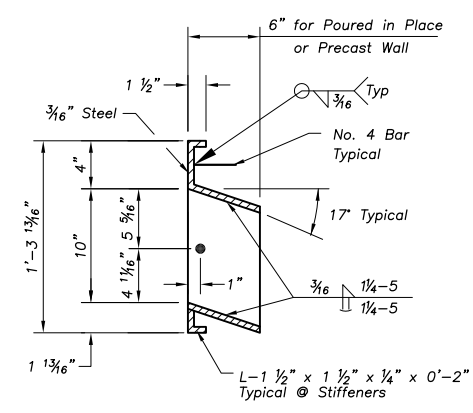

Section A-A
Not to Scale

Area Inlet Frame Notes

- All welds shall be performed in accordance with appropriate AWS Specifications and Procedures.
- All welds on exposed surfaces shall be dressed so as to provide a pleasing finished appearance.
- All flat steel shall be 7 Gage or 3/16" thick.
- The entire frame shall be hot dip zinc coated in accordance with ASTM A-123.

AREA INLET FRAME

(2012 Edition)

Year 2012 Edition

REVISIONS:	
05/20/03	Notes
07/01/03	Concrete Mix Designation
Jan. 2006	Miscellaneous
RELATED ORDINANCES:	
OPMC Title 15	



DEPARTMENT OF PUBLIC WORKS
STANDARD DETAILS

AREA INLET DETAILS