



* - Must extend full width of ingress and egress operation

Plan View
Not to Scale

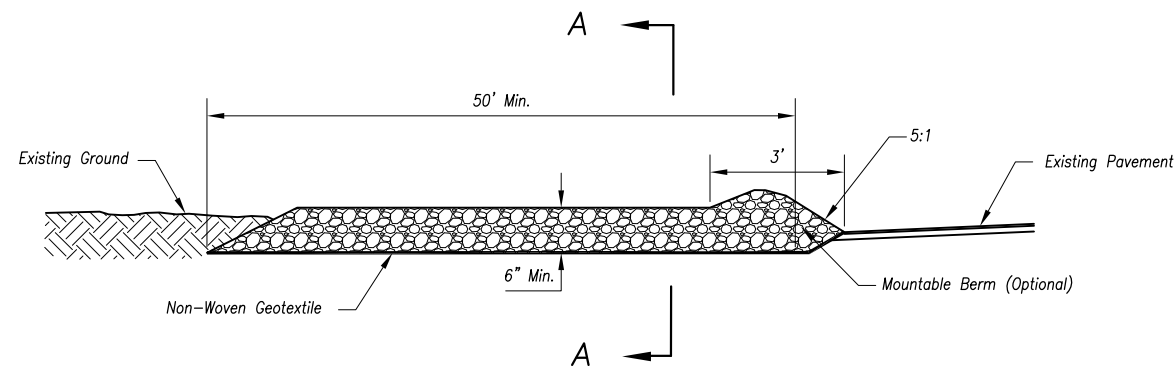

Side Elevation
Not to Scale

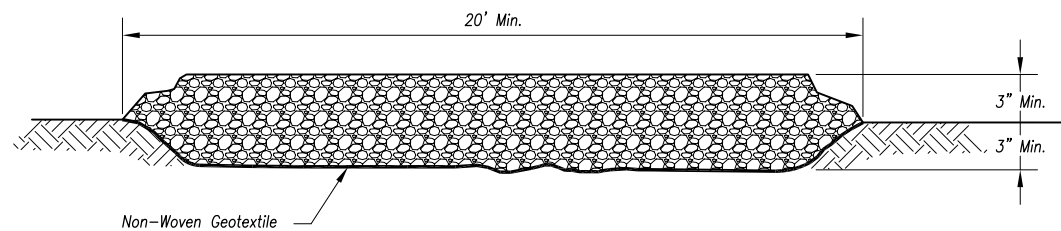

Section A-A
Not to Scale

Notes:


1. Overland Park Municipal Code (OPMC) and Overland Park Design and Construction Standards Manual (OPDCSM) are incorporated, except as otherwise noted.
2. Avoid locating on steep slopes, at curves on public roads, or downhill of disturbed area.
3. Remove all vegetation and other unsuitable material from the foundation area, grade, and crown for positive drainage.
4. If slope towards the public road exceeds 2%, construct a 6- to 8-inch high ridge with 3H:1V side slopes across the foundation approximately 15 feet from the edge of the public road to divert runoff from it.
5. Install pipe under the entrance if needed to maintain drainage ditches along public roads.
6. Place stone to dimensions and grade as shown on plans. Leave surface sloped for drainage.
7. Divert all surface runoff and drainage from the entrance to a sediment control device.
8. If conditions warrant, place geotextile fabric on the graded foundation to improve stability.

Maintenance:

Reshape entrance as needed to maintain function and integrity of installation. Top dress with clean aggregate as needed.

CONSTRUCTION ENTRANCE

Year 2018 Edition

REVISIONS:	 ABOVE AND BEYOND. BY DESIGN.
RELATED ORDINANCES: OPMC Title 15	
DEPARTMENT OF PUBLIC WORKS STANDARD DETAILS	CONSTRUCTION ENTRANCE
WEB SITE ADDRESS: http://www.opkansas.org/_bus/pre-construction_resources	
DATE: 01/10/2012	SHEET: 49